

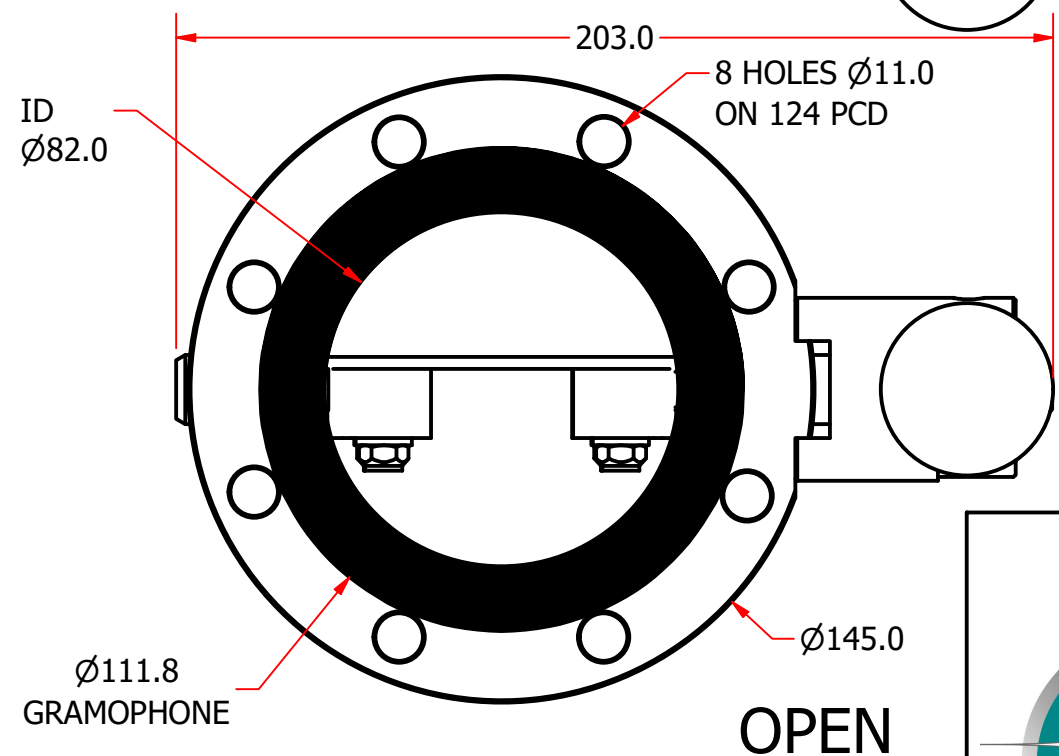
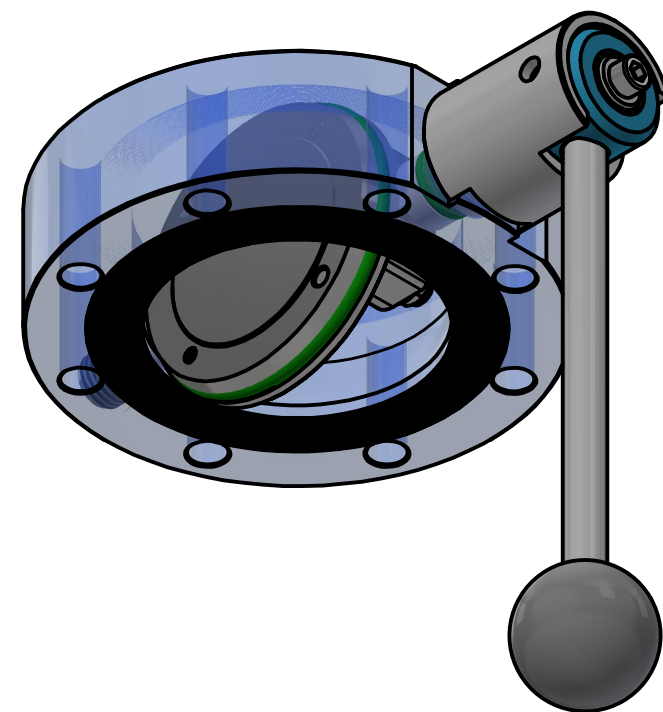


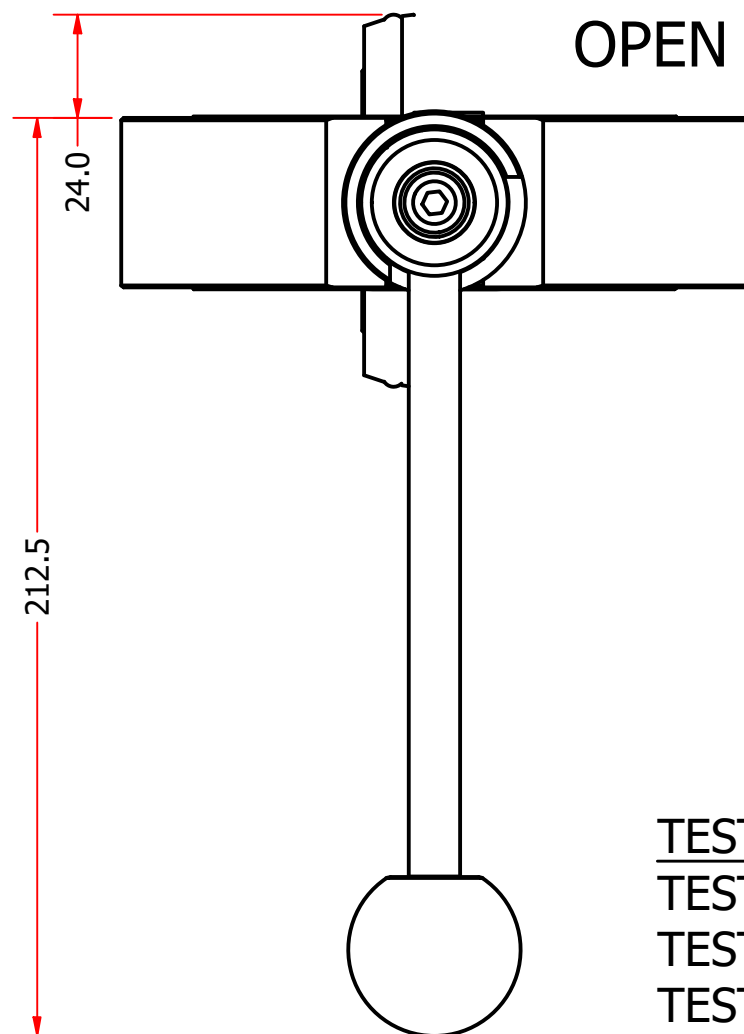

TEST B OPERABILITY
TEST FLUID: WATER
TEST FROM THE INLET SIDE
TEST PRESSURE: 500 kPa
TEST DURATION: 5 MIN

TEST C OPERABILITY
TEST FLUID: WATER
TEST FROM THE OUTLET SIDE
TEST PRESSURE: 27 kPa
TEST DURATION: 5 MIN

NO TRANSFER OF INTELLECTUAL PROPERTY : Any & all drawings, documentation, information or data provided by AMF to be used solely for the use intended by AMF, nor may it be shared, copied, distributed or disseminated in any manner whatsoever. All intellectual property, including AMF's drawings, shall remain the sole property of AMF.

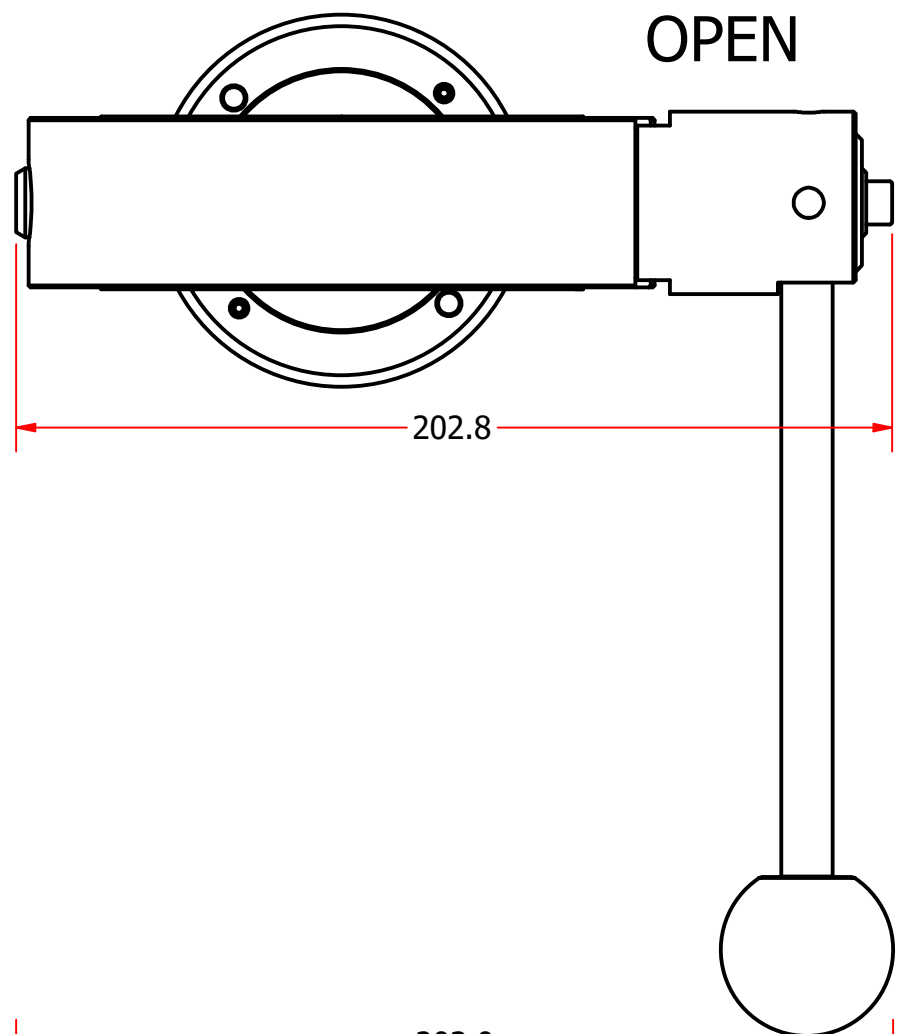

APPROVED
R.P.M.J.

TITLE

BUTTERFLY VALVE 80mm MANUAL
GENERAL ARRANGEMENT

SIZE

A3

DWG NO

AMF_BF_80_MAN_ADR_316L

REV

2

SCALE

1 : 1

SHEET 2 OF 2